


ON FIRE SERVICES, ANY USE OF NON-METALLIC PIPE ABOVE GROUND IS RESTRICTED TO UPSTREAM OF THE LAST UPTURNED BEND ON THE RISER TO THE ASSEMBLY.
NOTE: USE OF GALVANISED WROUGHT IRON PIPE (GWIP) IS PROHIBITED IN ANY PART OF THE INSTALLATION UPSTREAM OF THE ASSEMBLY.


FOR DETAILS OF GENERAL WATER VALVING ARRANGEMENTS SEE DRAWING NUMBERS 1 - 7

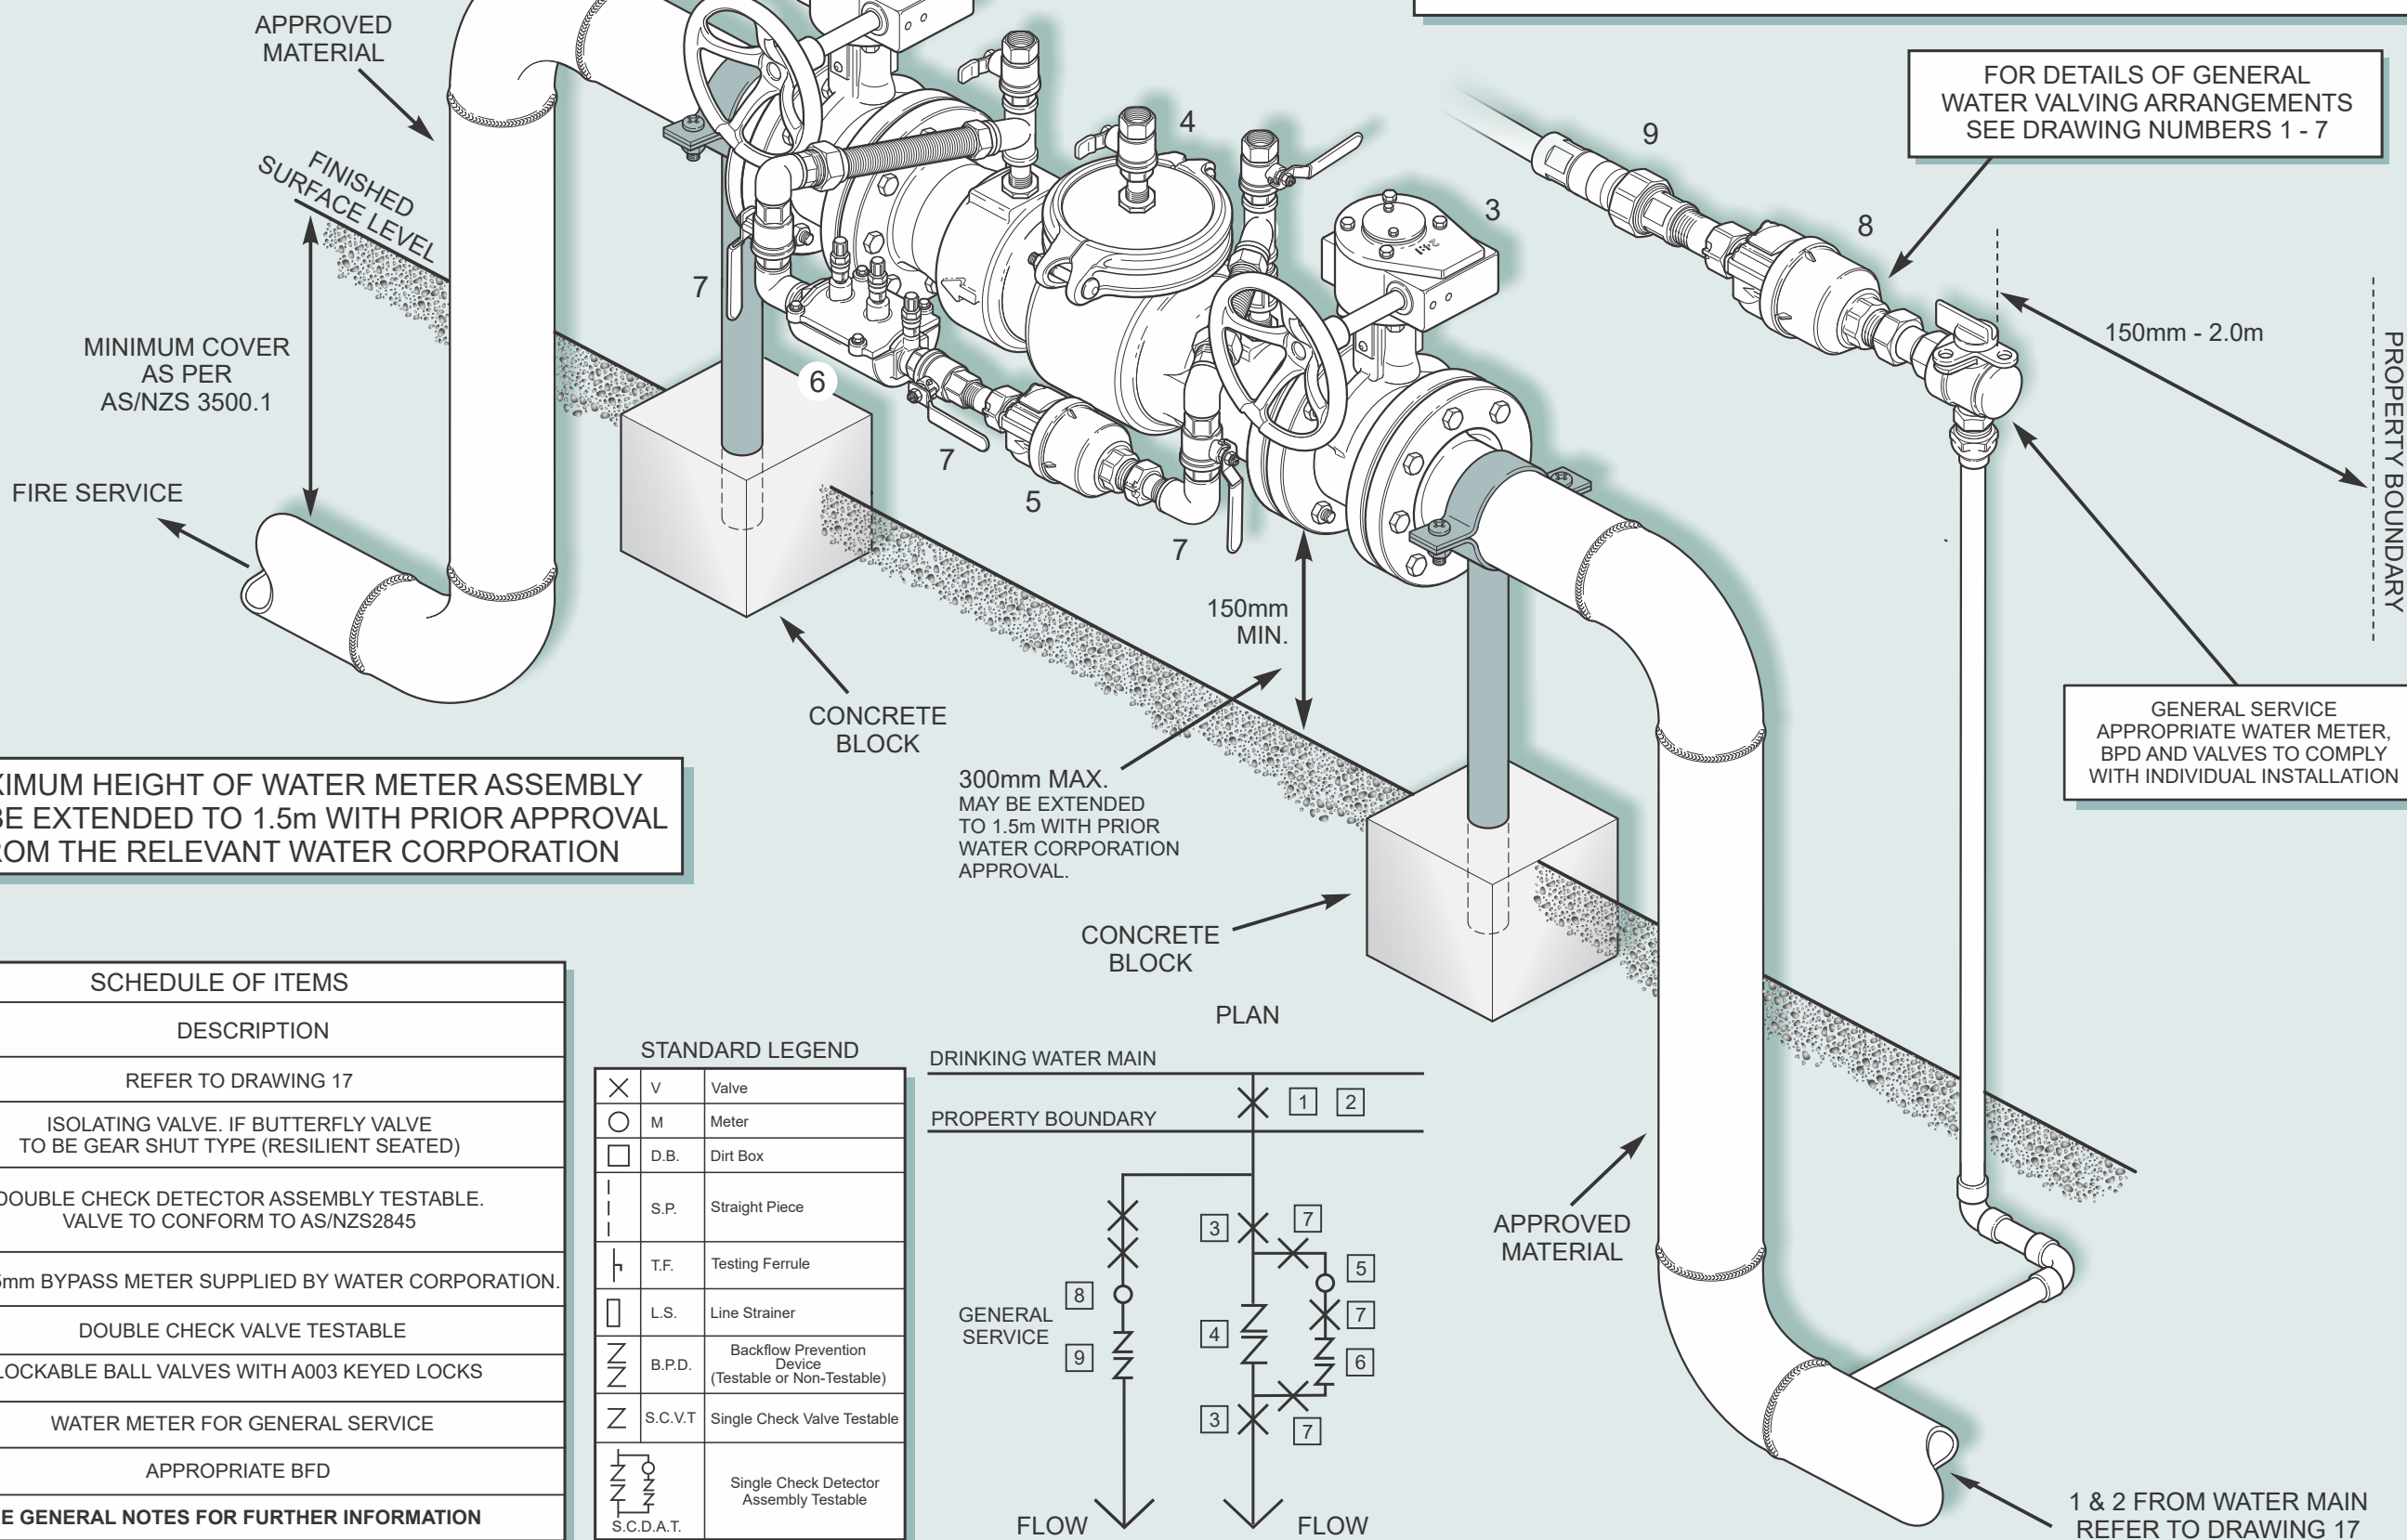

MAXIMUM HEIGHT OF WATER METER ASSEMBLY MAY BE EXTENDED TO 1.5m WITH PRIOR APPROVAL FROM THE RELEVANT WATER CORPORATION

SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE (RESILIENT SEATED)
4	DOUBLE CHECK DETECTOR ASSEMBLY TESTABLE. VALVE TO CONFORM TO AS/NZS2845
5	25mm BYPASS METER SUPPLIED BY WATER CORPORATION.
6	DOUBLE CHECK VALVE TESTABLE
7	LOCKABLE BALL VALVES WITH A003 KEYED LOCKS
8	WATER METER FOR GENERAL SERVICE
9	APPROPRIATE BFD
SEE GENERAL NOTES FOR FURTHER INFORMATION	

STANDARD LEGEND		
×	V	Valve
○	M	Meter
□	D.B.	Dirt Box
—	S.P.	Straight Piece
⊥	T.F.	Testing Ferrule
▭	L.S.	Line Strainer
≡	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
⌌	S.C.V.T.	Single Check Valve Testable
⌌	S.C.D.A.T.	Single Check Detector Assembly Testable

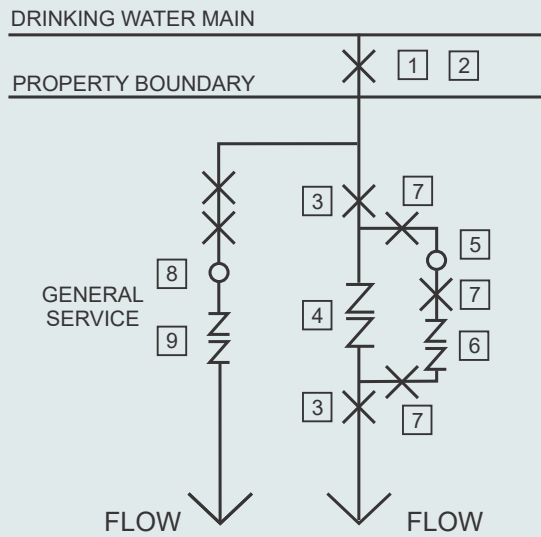

DRAWING NUMBER:

10

SCALE:

NOT TO SCALE

DATE:

JULY 2017

80mm+ FIRE HYDRANT / HOSE REELS WITH DOUBLE CHECK DETECTOR ASSEMBLY TESTABLE TYPICAL ARRANGEMENT

